
Remote control

iTL impulse relays (cont.)

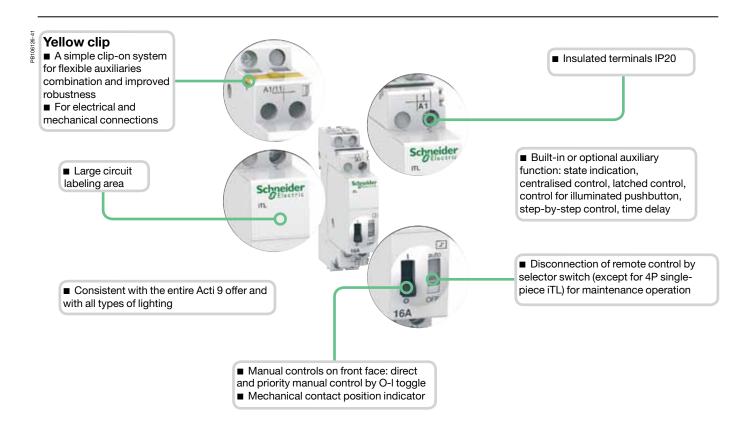

		Choice impulse relays auxiliaries																	
Туре		Standard iTL						Changeover iTLI					iTLc centralised control			iTLm control on latched order	iTLs remote indication		
Rating	Α	16					32	16					16			16	16		
Control voltage	VAC	230/ 240	130	48	24	12	230/ 240	230/ 240	130	48	24	12	230/ 240	48	24	230/ 240	230/ 240	48	24
	V DC	110	48	24	12	6	110	110	48	24	12	6	-			-	110	24	12
Auxiliaries																			
Extension		_		_	_					_	_			_		_			
iETL		•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Centralised co	ntrol + indi	cation																	
iATLc+s		•	•	•	•	-	•	•	•	•	-	-	-	-	-	-	•	•	
Centralised co	ntrol																		
iATLc		•	•	•	-	-	-	•	•	-	-	-	-	-	-	-	=	•	•
Indication																			
iATLs		•	•	-	-	-	-	•	•	-	-	•	•	-	-	•	=	•	-
Multi-level cen	tralised co	ntrol																	
iATLc+c		•	•	•	•	-	•	•	•	•	-	-	•	•	-	-	•	•	•
Latched contro	ol																		
iATLm		•	•	•	•	•	•	•	•	•	•	•	-	-	-	-	•	•	•
Control for illur	minated Pu	ıshbutt	on																
iATLz		•	•	-	-	-	•	•	•	-	-	-	•	•	-	-	•	•	-
Step by step co	ontrol																		
iATL4		•	-	-	-	-	-	-	-	-	-	-	•	-	-	-	•	-	-
Time delay con	itrol																		
iATEt		•	•	■ (*)	•	-	-	-	•	•	■ (*)) -	•	•	-	-	•	•	■ (*)
Control and inc	dication																		
iATL24		•	-	-	-	-	•	-	-	-	-	-	•	-	-	-	•	-	-
(*) iATEt : does no	ot operate o	on 12 V	DC.													•			

Tachnical

Technical Section 11 Dimensions Section 12